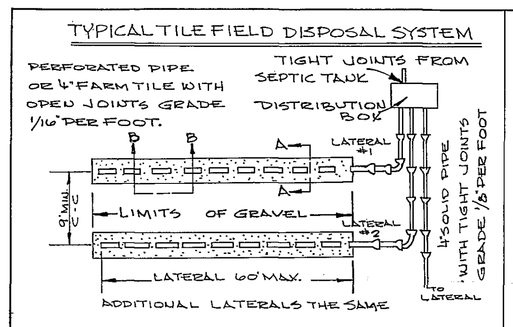

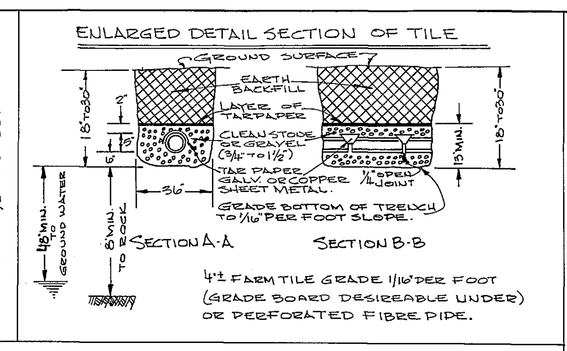

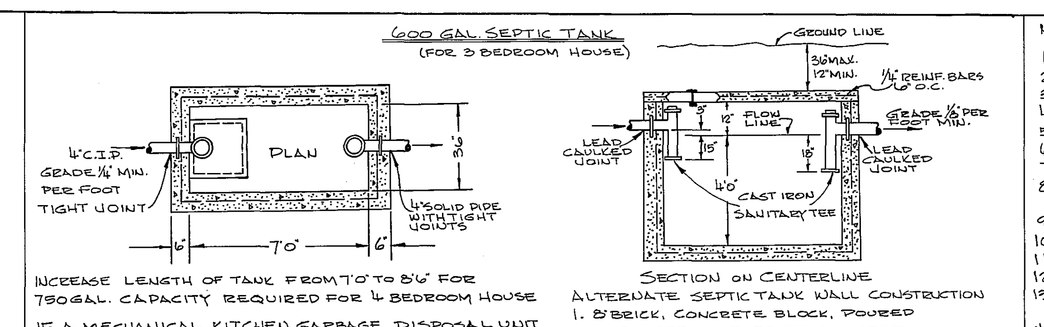

INCREASE LENGTH OF TANK FROM 7' TO 8'6" FOR 750 GAL. CAPACITY REQUIRED FOR 4 BEDROOM HOUSE

IF A MECHANICAL KITCHEN GARBAGE DISPOSAL UNIT IS INSTALLED, INCREASE VOLUME OF SEPTIC TANK BY 50% AND LEACHING AREA OF TILE FIELD BY 20%

ALTERNATE SEPTIC TANK WALL CONSTRUCTION
1. 8" BRICK, CONCRETE BLOCK, POURED CONCRETE OR PRECAST CONCRETE.
2. CON'L. STD. (177.61) OR (177.62) OR EQUIV. METAL TANK.

NOTES:

1. ONE PRINCIPLE DWELLING UNIT PER LOT.
2. 600 GALLON SEPTIC TANK SUITABLE FOR A 3 BEDROOM HOUSE, FOR EACH BEDROOM OVER 3, INCREASE VOLUME BY 150 GALLONS.
3. ALL TILE FIELD LATERALS TO BE OF EQUAL LENGTH AND LAID PARALLEL TO CONTOURS.
4. LATERALS SHALL NOT BE PLACED BENEATH A DRIVEWAY.
5. ALL LAUNDRY AND KITCHEN WASTE SHALL BE DISCHARGED INTO THE SEWAGE DISPOSAL SYSTEM AS SHOWN.
6. NO CELLAR, FOOTING OR ROOF DRAINS ARE TO DISCHARGE INTO THE SEWAGE DISPOSAL SYSTEM.
7. IF THE WELL IS AT A LOWER ELEV. THAN THE TILE FIELD, THE WELL SHALL BE LOCATED A MINIMUM OF 200' FROM THE TILE FIELD.
8. NO SEWAGE DISPOSAL SYSTEM TO BE PLACED WITHIN 20' OF TOP OF BANK OF ANY WATER COURSE, DRAINAGE DITCH OR STORM SEWER PIPE.
9. SEWER LINES PASSING WITHIN 50' OF ANY WELL SHALL BE OF CAST IRON PIPE WITH LEAD JOINTS.
10. NO SEWAGE DISPOSAL SYSTEM WITHIN 100' OF HIGH WATER MARK OF ANY STREAM, LAKE OR POND.
11. ALL TREES WITHIN THE TILE FIELD AREA MUST BE REMOVED PRIOR TO CONSTRUCTION.
12. GRADING NOT TO EXCEED ONE FOOT IN TILE FIELD AREA.
13. THERE SHALL BE NO REDEVELOPMENT OF ANY LOT AS SHOWN ON THIS PLAN WITHOUT APPROVAL FROM THE DUTCHESS COUNTY DEPT. OF HEALTH AND THE TOWN OF WASHINGTON PLANNING BOARD.
14. THE DUTCHESS COUNTY DEPT. OF HEALTH SHALL BE NOTIFIED BEFORE BACKFILLING OF COMPLETED SEWAGE DISPOSAL SYSTEM SO THAT A FINAL INSPECTION BY A DEPT. REPRESENTATIVE CAN BE MADE.
15. ALL SEWAGE DISPOSAL SYSTEMS SHALL BE LOCATED IN THE EXACT LOCATION AS SHOWN ON THIS PLAN UNLESS OTHERWISE AUTHORIZED BY THE DUTCHESS COUNTY DEPT. OF HEALTH.
16. THE BACKFILL MATERIAL TO BE USED IN THE TILE FIELD TRENCHES SHALL CONTAIN NO PARTICLE IN EXCESS OF 4" GREATEST DIMENSION AND MUST BE APPROVED BEFORE PLACING BY THE DUTCHESS COUNTY DEPT. OF HEALTH.

SPECIAL NOTES: (FILL SECTION)

1. ALL FILL SHALL BE OF RUN-OF-BANK GRAVEL.
2. THE AREA FOR THE SEWAGE DISPOSAL SYSTEM MUST BE JOINTLY INSPECTED BY THE CONTRACTOR OR OWNER AND A REPRESENTATIVE OF THE DUTCHESS COUNTY HEALTH DEPT. PRIOR TO CONSTRUCTION, OR ISSUANCE OF BUILDING PERMIT.
3. BACKFILL MATERIAL FOR TILE TRENCHES SHALL CONTAIN NO PARTICLES WITH ANY DIMENSION GREATER THAN 4". BACKFILL MATERIAL MUST BE INSPECTED AND APPROVED BY THE DUTCHESS COUNTY HEALTH DEPT. BEFORE INSTALLATION.
4. THE DUTCHESS COUNTY HEALTH DEPT. SHALL BE NOTIFIED BEFORE BACKFILLING ON ANY SEWAGE DISPOSAL SYSTEM SO THAT A FINAL INSPECTION BY A DEPT. REPRESENTATIVE CAN BE MADE.

* SPECIAL NOTE FROM:
DUTCHESS COUNTY DEPARTMENT OF HEALTH
ANY CHANGE OR DEVIATION IN
ANY Subdivision Details
AS SHOWN AND APPROVED ON THIS PLAN SHALL RENDER THAT FACILITY UNACCEPTABLE AND THEREFORE DISAPPROVED, UNLESS THE CHANGE OR DEVIATION IS APPROVED IN WRITING BY THE DUTCHESS COUNTY DEPARTMENT OF HEALTH BEFORE ANY CONSTRUCTION BEGINS.

Peter J. Rothermel, M.D.
Deputy COMMISSIONER OF HEALTH
N.W. Sonabele P.E.
DIRECTOR OF ENVIRONMENTAL SANITATION

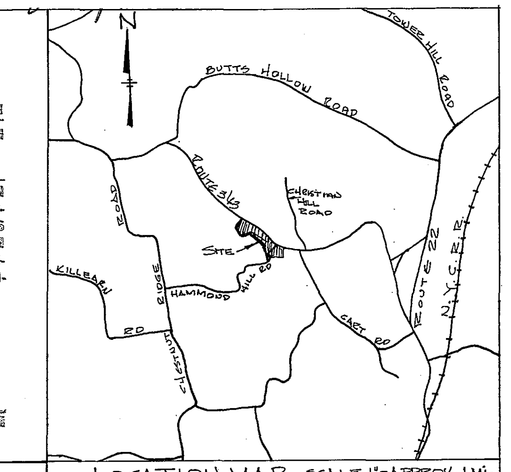

DUTCHESS COUNTY DEPARTMENT OF HEALTH
POUGHKEEPSIE, N. Y.

THIS IS TO CERTIFY THAT THE PROPOSED ARRANGEMENTS FOR WATER SUPPLY AND SEWAGE DISPOSAL FOR Plymouth Hills Inc. IN THE Town of Washington WERE APPROVED ON June 9, 1969 IN ACCORDANCE WITH PLANS ON FILE IN THE OFFICE OF THE DUTCHESS COUNTY DEPARTMENT OF HEALTH. CONSENT IS HEREBY GIVEN TO THE FILING OF THE MAP OF WHICH THIS ENDORSEMENT APPEARS IN THE OFFICE OF THE COUNTY CLERK OF THE DUTCHESS COUNTY IN ACCORDANCE WITH THE PROVISIONS OF CHAPTER 18 OF THE DUTCHESS PART-COUNTY SANITARY CODE

Peter J. Rothermel, M.D.
Deputy COMMISSIONER OF HEALTH
N.W. Sonabele P.E.
DIRECTOR OF ENVIRONMENTAL SANITATION

June 25 1969
Approved by Town of Washington
Village of Millbrook Planning Board
Robert W. Whalen
Chairman

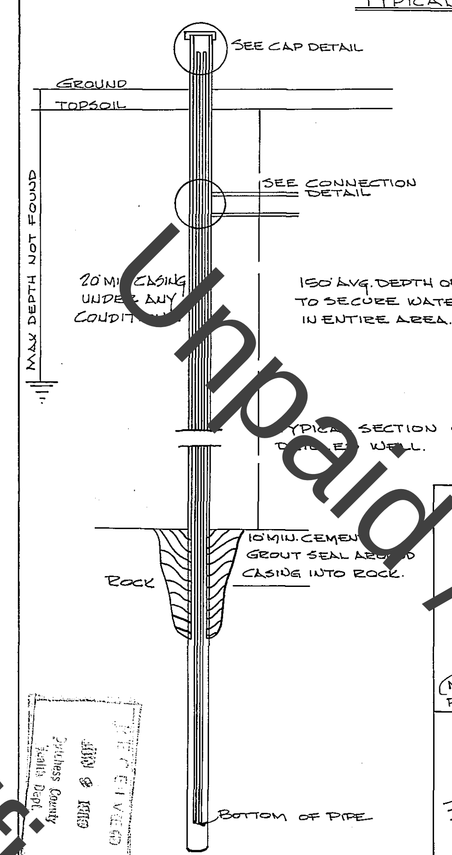

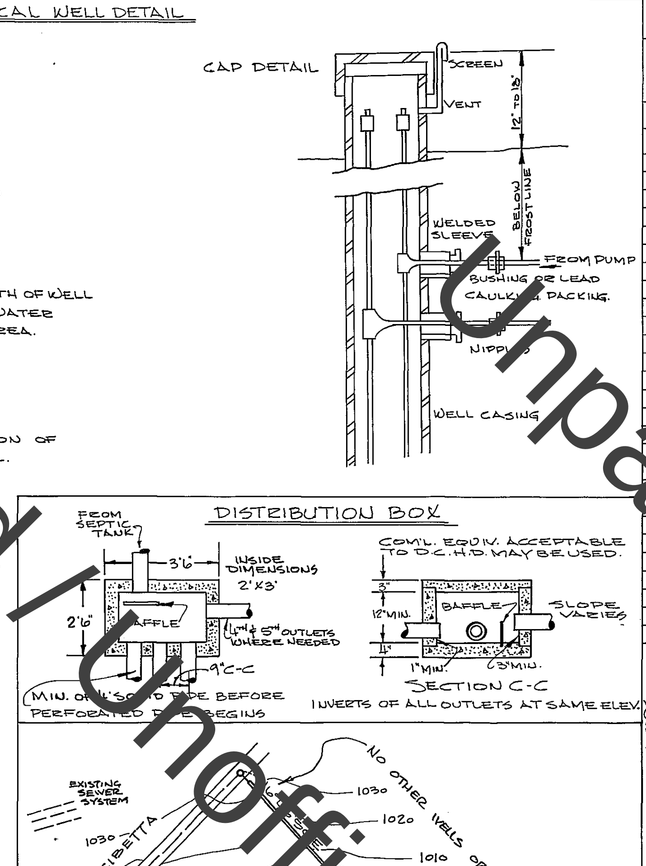

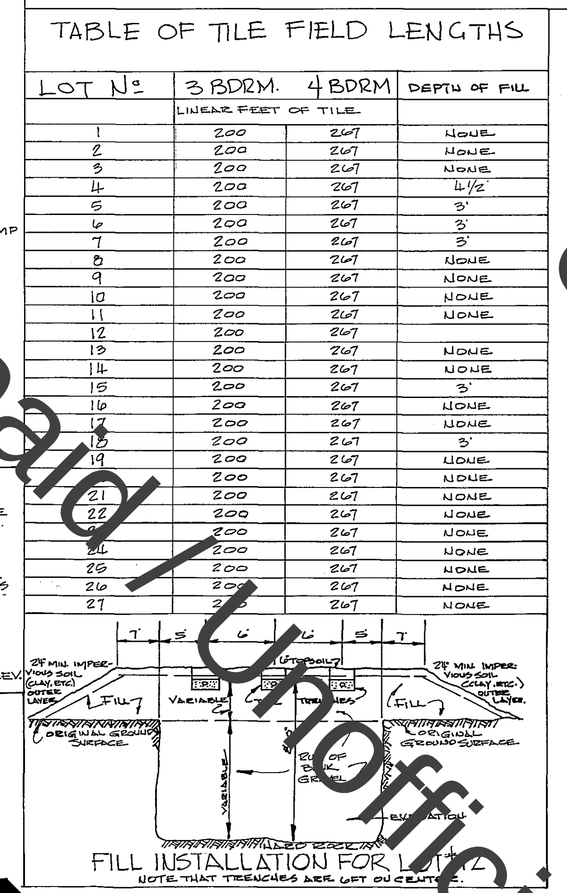

TABLE OF TILE FIELD LENGTHS

LOT Nº	3 BDRM. LINEAR FEET OF TILE.	4 BDRM	DEPTH OF FILL
1	200	247	NONE.
2	200	247	NONE.
3	200	247	NONE.
4	200	247	4 1/2'
5	200	247	3'
6	200	247	3'
7	200	247	3'
8	200	247	NONE.
9	200	247	NONE.
10	200	247	NONE.
11	200	247	NONE.
12	200	247	NONE.
13	200	247	NONE.
14	200	247	NONE.
15	200	247	3'
16	200	247	NONE.
17	200	247	NONE.
18	200	247	3'
19	200	247	NONE.
20	200	247	NONE.
21	200	247	NONE.
22	200	247	NONE.
23	200	247	NONE.
24	200	247	NONE.
25	200	247	NONE.
26	200	247	NONE.
27	200	247	NONE.

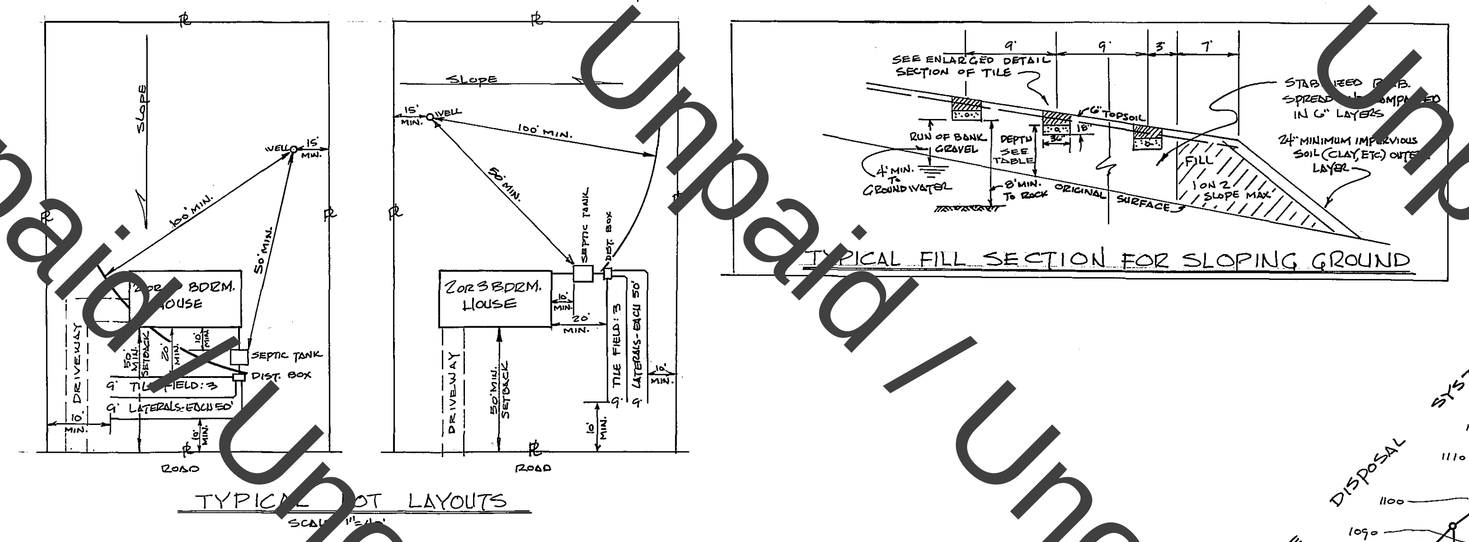

LEGEND:
⊗ DEEP TEST HOLE
① PERCOLATION TEST HOLE

NOTE: SPECIAL CONDITIONS OF PLANNING BOARD APPROVAL - HIGHWAY ACCESS LIMITATIONS.
LOT # 18 - ONE DRIVEWAY PERMIT ONLY
" 20 - NO ACCESS PERMIT FROM FRONTAGE OF THIS LOT TO HIGHWAY.
" 22 - ONE DRIVEWAY PERMIT ONLY
" 24 - NO ACCESS PERMIT FROM FRONTAGE OF THIS LOT TO HIGHWAY.
" 26 - ONE DRIVEWAY PERMIT ONLY.

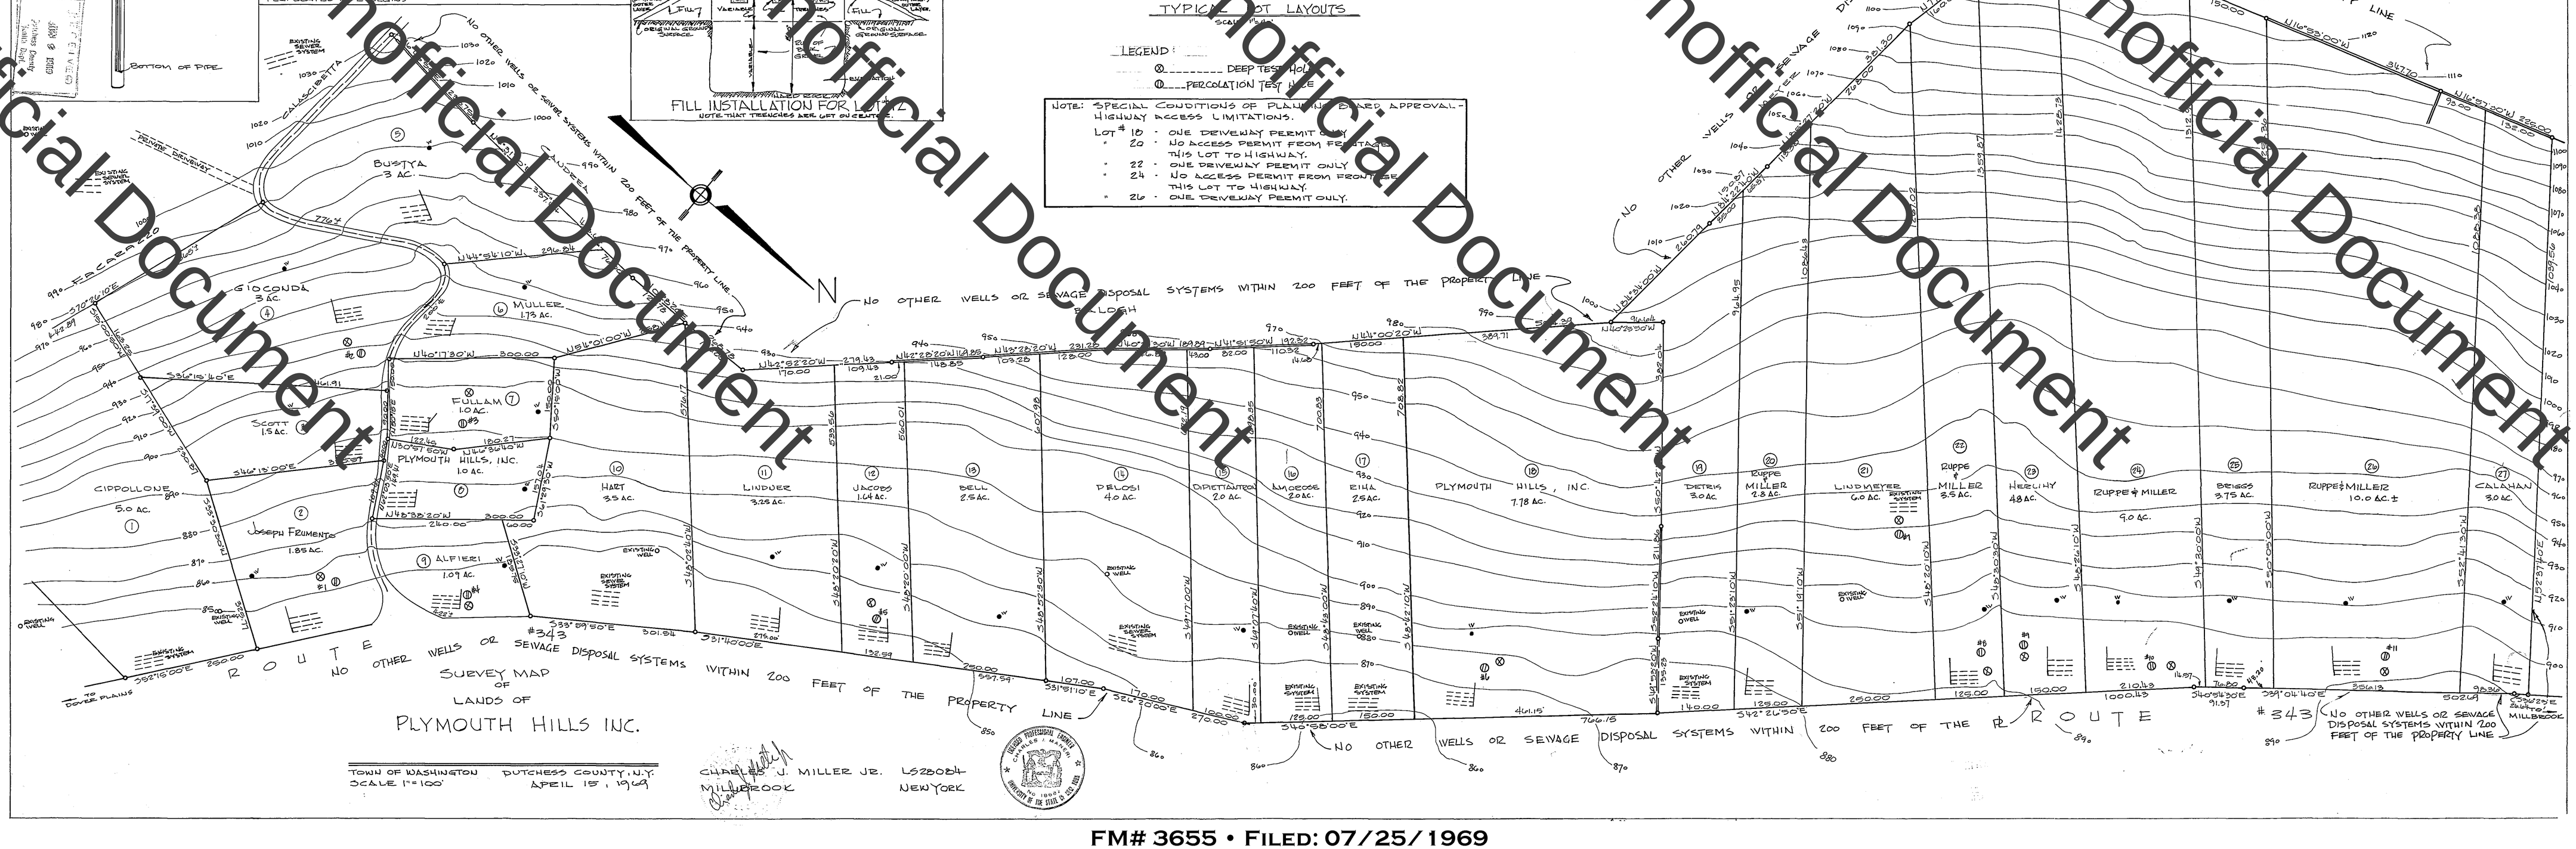

Unpaid / Unofficial Document