


GENERAL CONSTRUCTION NOTES: 1. WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL SHOULD VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS OF THE JOB AND SHALL NOTIFY THIS OFFICE OF ANY VARIATIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN ON THESE DRAWINGS. SHOP DRAWINGS MUST BE SUBMITTED TO THE OWNER BEFORE PROCEEDING WITH THE FABRICATION OF STAIRS ROOF AND/OR FLOOR TRUSSES. 2. WHERE DRAWINGS ARE IN CONFLICT WITH OTHER DRAWINGS, SPECS OR DETAILS, THE CONTRACTOR SHALL CONTACT THE ARCHITECT FOR CLARIFICATION. 3. PROVIDE TRANSITION STRIPS AT ALL CHANGES IN FLOOR FINISHES. 4. ALL CLOSETS TO HAVE THE SAME FINISH AS THE ADJOINING ROOM UNLESS OTHERWISE NOTED. 5. PROVIDE 22-1/2" x 30" ATTIC ACCESS WITH SWITCHED LIGHT UNLESS OTHERWISE NOTED. 6. PROVIDE PLUMBING FIXTURE ACCESS PANEL AT EACH TUB AND SHOWER ENCLOSURE AS REQUIRED BY LOCAL JURISDICTION. 7. PROVIDE HANDRAILS 30"-38" ABOVE NOSINGS ON ALL STAIRS W/ THREE OR MORE RISERS. RETURN RAILS TO WALL OR NEWEL. REQUIRED HANDRAILS SHALL BE CONTINUOUS THE FULL LENGTH OF STAIR. PROVIDE GUARDRAILS AT RAISED FLOORS, BALCONIES, ETC., 30" OR MORE ABOVE GRADE OR FLOOR BELOW. GUARDS SHALL BE MIN 80" HIGH AND HAVE CLOSURES SPACED TO PREVENT PASSAGE OF A 4" SPHERE. 8. PROVIDE NOMINAL 2X FIVE BLOCKING AT EVERY FLOOR INTERVAL. BELUKHEAD AND CHASE. IF OPEN WEB FLOOR TRUSSES ARE UTILIZED PROVIDE 1/2" G.B. DRAFTSTOPPING, NOT TO EXCEED 240 S.F. 9. PROVIDE A MINIMUM OF TWO DIAGONAL BRACES AT APPROX 45 DEGREE ANGLE AT MIDPOINT OF SPAN FROM BOTTOM CHORD TO RIDGE OF ROOF TRUSSES. INSTALL OTHER BRACES AS REQUIRED BY THE TRUSS MANUFACTURER'S SHOP DRAWINGS AND IN COMPLIANCE WITH HIS 91 SUPPLIED BY MANUFACTURER. 10. PROVIDE A MINIMUM OF 6'-9" HEAD CLEARANCE FOR ALL STAIRS. STAIR RISERS SHALL NOT EXCEED 8-1/4" AND TREADS SHALL BE AT LEAST 9" WITH 1" NOSING. 11. PROVIDE SQUIRT VENTS, RIDGE VENTS, OR GABLE END VENTS AS SHOWN ON THE DRAWINGS. MAINTAIN MINIMUM 1/200 FREE VENTILATION FOR HORIZONTALLY PROJECTED ROOF AREA. INSTALL PLASTIC OR CARBORUNDUM BASTELS IN ROOF TRUSS/RAFTER BAY TO MAINTAIN FREE AIR FLOW. 12. MECHANICAL, PLUMBING, AND ELECTRICAL CONTRACTORS SHALL BE RESPONSIBLE TO SEAL ALL PENETRATIONS IN FLOORS AND EXTERIOR WALLS CAUSED BY THEIR TRADES. 13. ROUGH CARPENTRY CONTRACTORS SHALL SEAL ALL PANEL BUTT JOINTS AND PLATES AT FLOORS, CEILINGS, WINDOWS, DOOR JAMBS, AND LAMBS. 14. SHEATHING PENETRATION SHALL BE PATCHED AND REPAIRED TO MANUFACTURES SPECIFICATIONS. 15. SLOPE ALL STOODS, PORCHES, WALKS, AND GARAGE SLABS 1/8" IN 12" TO DRAIN OR AS NOTED ON PLANS. 16. ALL DESIGNS FOR MANUFACTURED FLOOR, JOIST, RAFTERS, AND TRUSSES SHALL BE CERTIFIED BY THE MANUFACTURE. 17. INSTALLATION OF SUCH ITEMS SHALL BE IN STRICT ACCORDANCE WITH MANUFACTURES SHOP DRAWINGS AND RECOMMENDATIONS. 18. CHIMNEYS SHALL EXTEND A MINIMUM OF 2' ABOVE ANY ROOF STRUCTURE WITH IN 10 FEET, BUT OT LESS THAN 3' AT POINT OF ROOF PENETRATION. 19. FLOOR JOIST/TRUSSES AND ROOF TRUSSES SHALL ALIGN WITH BEARING STUDS +/- 1" 20. PRIVATE GARAGES SHALL BE SEPARATED FROM DWELLING AND ATTIC WITH 1/2" GYPSON BOARD ON GARAGE SIDE. IF PERMIT IS ISSUED UNDER THE BOCA CODE, PROVIDE ONE-HOUR RATED SEPARTION BETWEEN GARAGE AND LIVING SPACES OVER OR IN ACCORDANCE WITH SPECIFIC REQUIREMENTS OF THE LOCAL JURISDICTION. 21. PROVIDE MINIMUM 8" STEP DOWN INTO GARAGE FROM DWELLING. SITE WORK: 1.03 THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, GRADES, BOUNDARIES, AND CONSTRUCTION BEFORE PROCEEDING WITH THE WORK AND REPORT IMMEDIATELY ANY DISCREPANCIES TO THE ARCHITECT AND/OR OWNER. 1.04 DESIGN LIFE LOADS: ROOF: 40 PSF 30 PSF SLEEPING FLOORS: 40 PSF LIVING FLOORS: 60 PSF EXTERIOR DECKS: 150 PSF 80 PSF STAIRS: 10 PSF GARAGE SLABS: 150 PSF 80 PSF ATTIC AREAS: UNACCESSIBLE: UNACCESSIBLE: 10 PSF UNACCESSIBLE: 20 PSF DESIGN DEAD LOADS: ROOF: 10 PSF 7 PSF CEILING: 10 PSF SLEEPING FLOORS: 15 PSF LIVING FLOORS: 20 PSF WIND LOAD: 15 PSF (EXPOSURE C) FLUID PRESSURE: 30 PCF MAXIMUM LOADS GREATER THAN 30 PCF REQUIRE FOUNDATION TO WALLS TO BE ENGINEERED SOIL BEARING 2000 PSF (ASSUMED) GUMP RAILS: 2004 AT ANY POINT IN ANY DIRECTION WITH EARTH. CONCRETE: 2.01 EXCAVATION SHALL BE SUFFICIENT TO PROVIDE FULL DESIGN DIMENSIONS OR TO ALLOW FOR FORMING AS REQUIRED. NO FOOTINGS SHALL BE PLACED ON SOFT OR FROZEN MATERIAL 2.02 MINIMUM SOIL BEARING CAPACITY IS ASSUMED TO BE 2000 PSF AT ALL WALL AND PIER FOOTINGS. IT IS THE OWNER'S RESPONSIBILITY TO VERIFY THAT THE ABOVE BEING CAPACITY IS OBTAINABLE, OR TO NOTIFY THE ARCHITECT IF SPECIAL DESIGN IS REQUIRED. 2.03 BACKFILL AND COMPACTION: USE ONLY CLEAN EARTH CONTAINING NO ORGANIC MATTER. GRADED WITH POSITIVE SLOPE. FILL BENEATH STRUCTURE SHALL BE COMPACTED TO 90% DENSITY AS PER ASTM D1557 METHOD D. 2.04 PROVIDE 4" MINIMUM CONTINUOUS DRAIN TILE AROUND PERIMETER OF BASEMENT FOUNDATION - LIACTION TO BE DETERMINED BY LOCAL CODES FOR INSIDE OR OUTSIDE OF FOUNDATION. PROVIDE UNDER SLAB VENTING AS REQUIRED BY LOCAL JURISDICTION. MASONRY: 4.01.0 THE MAXIMUM VERTICAL DISTANCE OF UNBALANCED FILL MEASURED FROM THE TOP OF THE LOWER LEVEL FLOOR SLAB TO THE OUTSIDE FINISHED GRADE SHALL NOT EXCEED THE FOLLOWING: HEIGHTS ARE FOR UNREINFORCED WALLS WHERE UNSTABLE SOIL OR GROUND WATER CONDITIONS DO NOT EXIST. 4.01.1 TYPE OF WALL HEIGHT OF FILL 8" CMU HOLLOW 4'-0" 12" CMU HOLLOW 6'-0" 8" POURED CONCRETE 7'-0" HEIGHTS MAY BE INCREASED WITH THE APPROVAL OF THE LOCAL JURISDICTION, OR REINFORCING. 4.01.2 PRESSURE TREATED WOOD IS TO MEET AMERICAN WOOD PRESERVES INSTITUTE STANDARD LP-2 OR PL-4 WOOD: 6.01 ALL STRUCTURAL LUMBER SHALL BE STAMPED IN ACCORDANCE WITH THE "CONSTRUCTION MANUAL" OF THE AMERICAN INSTITUTE OF TIMBER CONSTRUCTION. 6.02 PRESSURE TREATED WOOD IS TO MEET AMERICAN WOOD PRESERVES INSTITUTE STANDARD LP-2 OR PL-4 METALS: 5.01 STRAP ANCHORS OR ANCHOR BOLTS SHALL BE BOCA CODE AND BUILDING INSPECTOR APPROVED. MINIMUM (2) 1/2" BOLTS PER SECTION AT 6'-0" O.C. MAXIMUM. STRAP SPACING BY MANUFACTURE 5.02 METAL JOIST HANGERS (STANDARD WOOD LEDGER) SHALL BE USED WHERE REQUIRED AT JOISTS WITHOUT DIRECT BEARING AND BE AS APPROVED BY THE LOCAL JURISDICTION. THE INSTALLATION OF AN APPROVED FIRE SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH NFPA 130 MAY ALLEVATED THE NEED FOR F.R.T IN CERTAIN JURISDICTIONS - VERIFY WITH THE BUILDING CODE OFFICIAL 5.03 NAILS: USE NUMBER ANYTYPE FOR EACH APPLICATION AS CALLED FOR IN THE BOCA CODE, APPENDIX C, OR MANUFACTURES RECOMMENDED STANDARDS. 5.04 VENER TIES SHALL BE 1" WIDE, 22 GA. GALVANIZED STEEL. INSTALLED 24" OC HORIZONTALLY AND 16" OC VERTICALLY 5.05.0 STEEL LINTELS FOR ALL OPENINGS AND RECESSES IN BRICK OR BRICK FACED MASONRY WALL NOT SPECIFICALLY DETAILED: PROVIDE (1) STEEL ANGLE FOR EACH 4" OF WALL THICKNESS. STEEL ANGLES TO HAVE MINIMUM OF 6" BEARING AT EACH END. HORIZONTAL LEG SHALL BE 3-1/2" : UNLESS OTHERWISE SHOWN. 5.05.1 LINTEL SCHEDULE (UNLESS NOTED OTHERWISE ON PLANS): [=1 3-1/2" x 3-1/2" x 5/16" STEEL ANGLE UP TO 3' OPG. [=2 4" x 3-1/2" x 5/16" STEEL ANGLE 3' TO 5' OPG. [=3 5" x 3-1/2" x 3/8" STEEL ANGLE 5' TO 6'-6" OPG. [=4 6" x 3-1/2" x 3/2" STEEL ANGLE UP TO 9' OPG. [=5 6" x 4" x 5/8" STEEL ANGLE UP TO 10' OPG. [=6 8" OR 9" x 4" x 9/16" STEEL ANGLE 16" GARAGE DOOR OPG. LINTELS SHOWN SHALL NOT SUPPORT ANY SUPERIMPOSED LOADS. 5.05.2 ALL STEEL ANGLES IN MASONRY WALLS ARE TO BE FLASHED AND PAINTED. 5.05.3 PAINT ALL EXTERIOR FERROUS OR GALVANIZED METALS EXCEPT COMPLETELY PRE FINISHED FACTORY ITEMS. 5.06 ADJUSTABLE STEEL COLUMNS SHOWN ON THE DRAWINGS SHALL BE MANUFACTURED BY TUPRO (BOCA NO. 88-59), ARJO (BOCA NO. 91-42) OR CARDINAL (BOCA NO. 88-40) IN O.D. SIZES SPECIFIED. FINISHES: 7.01.0 DRYWALL: 1/2" TAPERED EDGE GYPSUM BOARD APPLIED, TAPED AND FINISHED IN ACCORDANCE WITH GYPSUM ASSOCIATION GA-216 AND ASTM-C-840 7.01.1 5/8" OR 1/2" GYPSUM BOARD IS TO BE USED TO COMPLETELY SEPARATE GARAGE FROM LIVING AREA, APPLIED ON GARAGE SIDE PER THE PLANS, OR IN MANOR ACCEPTABLE TO LOCAL JURISDICTION. (SEE GENERAL CONSTRUCTION NOTE #19) 7.01.2 PROVIDE RATED ASSEMBLIES AS DETAILED IN THE DRAWINGS FOR PARTWALLS OR OTHER RATED WALLS OR FLOORS. INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THE TESTING AGENCY'S REQUIREMENTS 7.02 WHEN CERAMIC TILE IS USED, WATER RESISTANT GYPSUM BOARD 1/2" THICK, OR APPROVED EQUAL, IS REQUIRED AT TUB AND SHOWER SURROUNDING TO A HEIGHT OF 36" ABOVE TUB OR SHOWER PAN. GLASS MESH AND CEMENT BOARD IS AN ACCEPTABLE ALTERNATE. DOORS & WINDOWS: 8.01 IF REVIEW IS UNDER THE 1993 BOCA CODE (UNMENDED) ALL INTERIOR DOORS, EXCEPT CLOSETS LESS THAN 10 SQFT SHALL BE MIN. 2'-6" IN WIDTH. 8.02 EACH SLEEPING ROOM SHALL HAVE AT LEAST ONE OPERABLE WINDOW PROVIDING 5.7 SQFT OF NET CLEAR OPENING WITH A SILL HEIGHT NOT MORE THAN 44" A.F.F. 8.03 SAFETY GLAZING (TEMPERED) SHALL BE PROVIDED IN SLIDING GLASS DOORS, SHOWER AND TUB ENCLOSURES AND WINDOWS WITHIN 6 FEET OF TUB SIDLIGHTS 8.04 FIXED PANEL GREATER THAN 9 SQFT WITHIN 18" A.F.F. OR WITH IN 36" OF A WALKING SURFACE. GLAZING WITHIN 12" OF A STAIR RAILING. 8.05 PROVIDED SELF-CLOSING DOOR BETWEEN DWELLING AND GARAGE. DOOR SHALL BE 1-3/4" THICK SOLID WOOD OR INSULATED STEEL W/ MIN. 20 MINUTE FIRE RATING. MECHANICAL: 15.01 HVAC AND PLUMBING CONTRACTORS SHALL COORDINATE ALL OPENINGS IN JOIST, TRUSSES, ETC., WITH GENERAL CONTRACTOR BEFORE PROCEEDING WITH ANY WORK. ALL WORK SHALL BE IN ACCORDANCE WITH ALL LOCAL MECHANICAL AND PLUMBING CODES. 15.02 PROVIDE ONE DAMPERED REGISTER PER 900 SQUARE FOOT OF UNFINISHED BASEMENT SPACE. 15.03 PROVIDE EXHAUST FANS AT EACH BATH AND VENT TO EXTERIOR OF HOUSE 15.04 DETACHED DWELLINGS CONSTRUCTED IN PRINCE GEORGES COUNTY MARYLAND AND ALL ATTACHED DWELLINGS CONSTRUCTED IN THE STATE OF MARYLAND SHALL INCLUDE A FIRE SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 130. 15.05 ALL DUCTWORK THAT PENETRATES ALL RATED WALL OR FLOOR ASSEMBLY SHALL BE PROVIDED WITH FIRE DAMPERS. 15.06 ALL VENTS AND FLUES SHALL BE INSTALLED WITH MINIMUM OF 2' CLEARANCE TO ADJACENT WOOD FRAMING GREATER IF SPECIFIED BY MANUFACTURE. 15.07 ANY PIPING PASSING UNDER FOOTINGS OR THROUGH A FOUNDATION WALL OR SLAB SHALL BE PROVIDED WITH A SLEEVE TWO PIPES LARGER THAN THE SUBJECT PIPE. 15.08 PROVIDE UNDER FLOOR PANS AND DRAINS FOR WASHER AND OR WATER HEATER WHEN LOCATED ON WOOD FLOOR SYSTEM. 15.09 PROVIDE HOSE BIBBS (FREEZE-PROOF OR WITH SHUT OFFS) AT FRONT AND REAR OF SINGLE FAMILY DWELLINGS. 15.10 PROVIDE 1-1/2" CONDENSATION LINE FROM WATER HEATER AND AIR HANDLER TO POSITIVE OUT FALL OR TO SUMP PUMP IF PROVIDED. SPECIALTIES: 9.03 PAINT (INTERIOR) UNLESS DIRECTED OTHERWISE: CEILINGS (1) COAT PRIMER (1) COAT FLAT LATEX FINISH WALLS (1) COAT PRIMER (1) COAT FLAT LATEX FINISH TRIM (1) COAT PRIMER (1 COAT SEMI-GLOSS ENAMEL FINISH 9.04 PAINT (EXTERIOR) UNLESS DIRECTED OTHERWISE: 1) TRIM: (1) COAT PRIMER (1) COAT FINISH OR EXTERIOR GRADE EXTERIOR LATEX SEMI-GLOSS ENAMEL. 9.05 CERAMIC TILE: WALLS: GLAZED MOSAIC TILE OVER WATER RESISTANT GYPSUM BOARD OR GLASS MESH MORTAR UNITS. USE THIN SET ORGANIC ADHESIVE (ANSI A108.4) OVER GYPSUM BOARD AND DRY-SET LATEX PORTLAND MORTAR (ANSI A108-3) OVER CEMENT BOARD FLOORS: GLAZED MOSAIC TILE OVER MINIMUM 5/8" PLYWOOD UNDERLAYMENT. SCHEDULE 12" OC TO SUBFLOOR. USE EPOXY MORTAR AND GROUT APPLICATION (ANSI A118-3) 9.06 RESILIENT FLOORS: SHEET VINYL RESILIENT FLOORING OVER 1/4" MIN. FIBERBOARD OR PLYWOOD UNDERLAYMENT. REVISIONS BY: DATE : 10/5/16 SCALE : 1/4" = 1' DRAWN : COVER SHEET SHEET NO. C.S. THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING TO BE COMPLETED PRIOR TO SITE FOR INFORMATION THAT PERTAINS SOLELY TO THE FABRICATION PROCESSES OR TO THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES OF CONSTRUCTION OF THE WORK OF ALL TRADES SAMPLES RESIDENCE DALLASTOWN PA



FRONT ELEVATION
Scale ; 1/4" = 1ft.

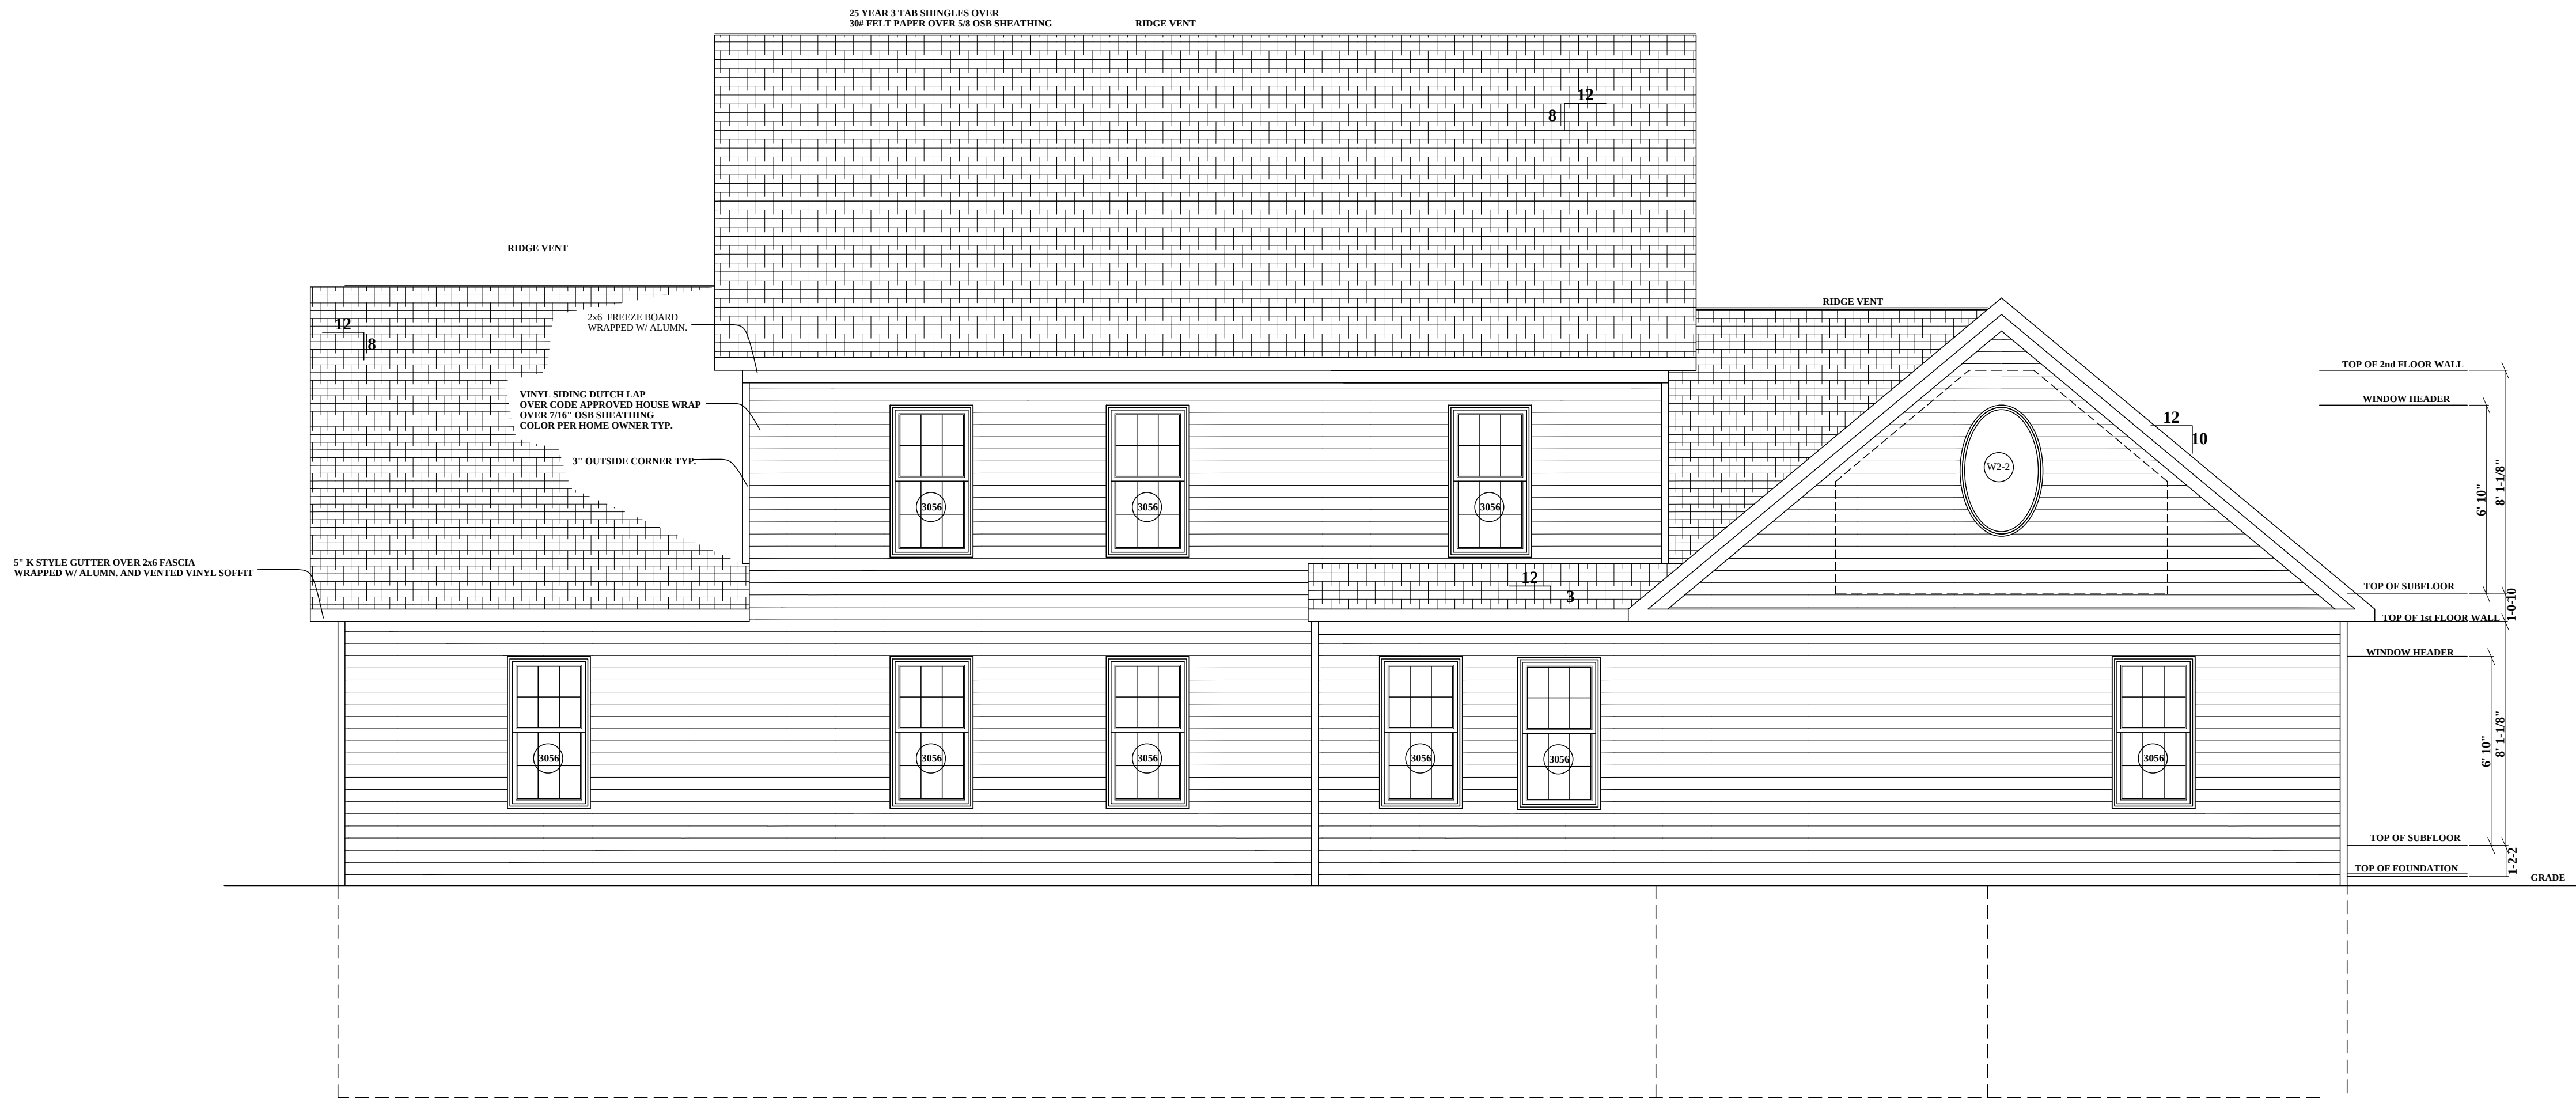

REAR ELEVATION
Scale ; 1/4" = 1ft.

REVISIONS	BY
7/23/16	MS
8/29/16	MS
9/16/16	MS
9/26/16	
10/5/16	

Samples Residence

THE CONTRACTOR IS
RESPONSIBLE FOR DIMENSIONS
TO BE CONFIRMED AND CORRELATED
AT SITE FOR INFORMATION THAT
PERTAINS SOLEY TO THE FABRICATION
PROCESSES OR TO THE MEANS,
METHODS, TECHNIQUES, SEQUENCES,
AND PROCEDURES OF CONSTRUCTION
OF THE WORK OF ALL TRADES

DATE : 10/5/16
SCALE :1/4" = 1'
DRAWN :

FRONT & REAR
ELEVATIONS

SHEET NO.
A-1



RIGHT ELEVATION

Scale ; 1/4" = 1ft.



LEFT ELEVATION

Scale ; 1/4" = 1ft.

REVISIONS	BY
7/23/16	MS
8/29/16	MS
9/16/16	MS
9/26/16	
10/5/16	

Samples Residence

THE CONTRACTOR IS RESPONSIBLE FOR DIMENSIONS TO BE CONFIRMED AND CORRELATED AT SITE FOR INFORMATION THAT PERTAINS SOLELY TO THE FABRICATION PROCESSES OR TO THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES OF CONSTRUCTION OF THE WORK OF ALL TRADES

DATE : 10/5/16

SCALE :1/4" = 1'

DRAWN :

RIGHT & LEFT ELEVATIONS

SHEET NO.

A-2

REVISIONS	BY
7/23/16	MS
8/29/16	MS
9/16/16	MS
9/26/16	
10/5/16	


Samples Residence

THE CONTRACTOR IS RESPONSIBLE FOR DIMENSIONS TO BE CONFIRMED AND CORRELATED AT SITE FOR INFORMATION THAT PERTAINS SOLEY TO THE FABRICATION PROCESSES OR TO THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES OF CONSTRUCTION OF THE WORK OF ALL TRADES

DATE : 10/5/16
SCALE : 1/4" = 1'
DRAWN :


1ST FLOOR
PLAN

SHEET NO.
A-4

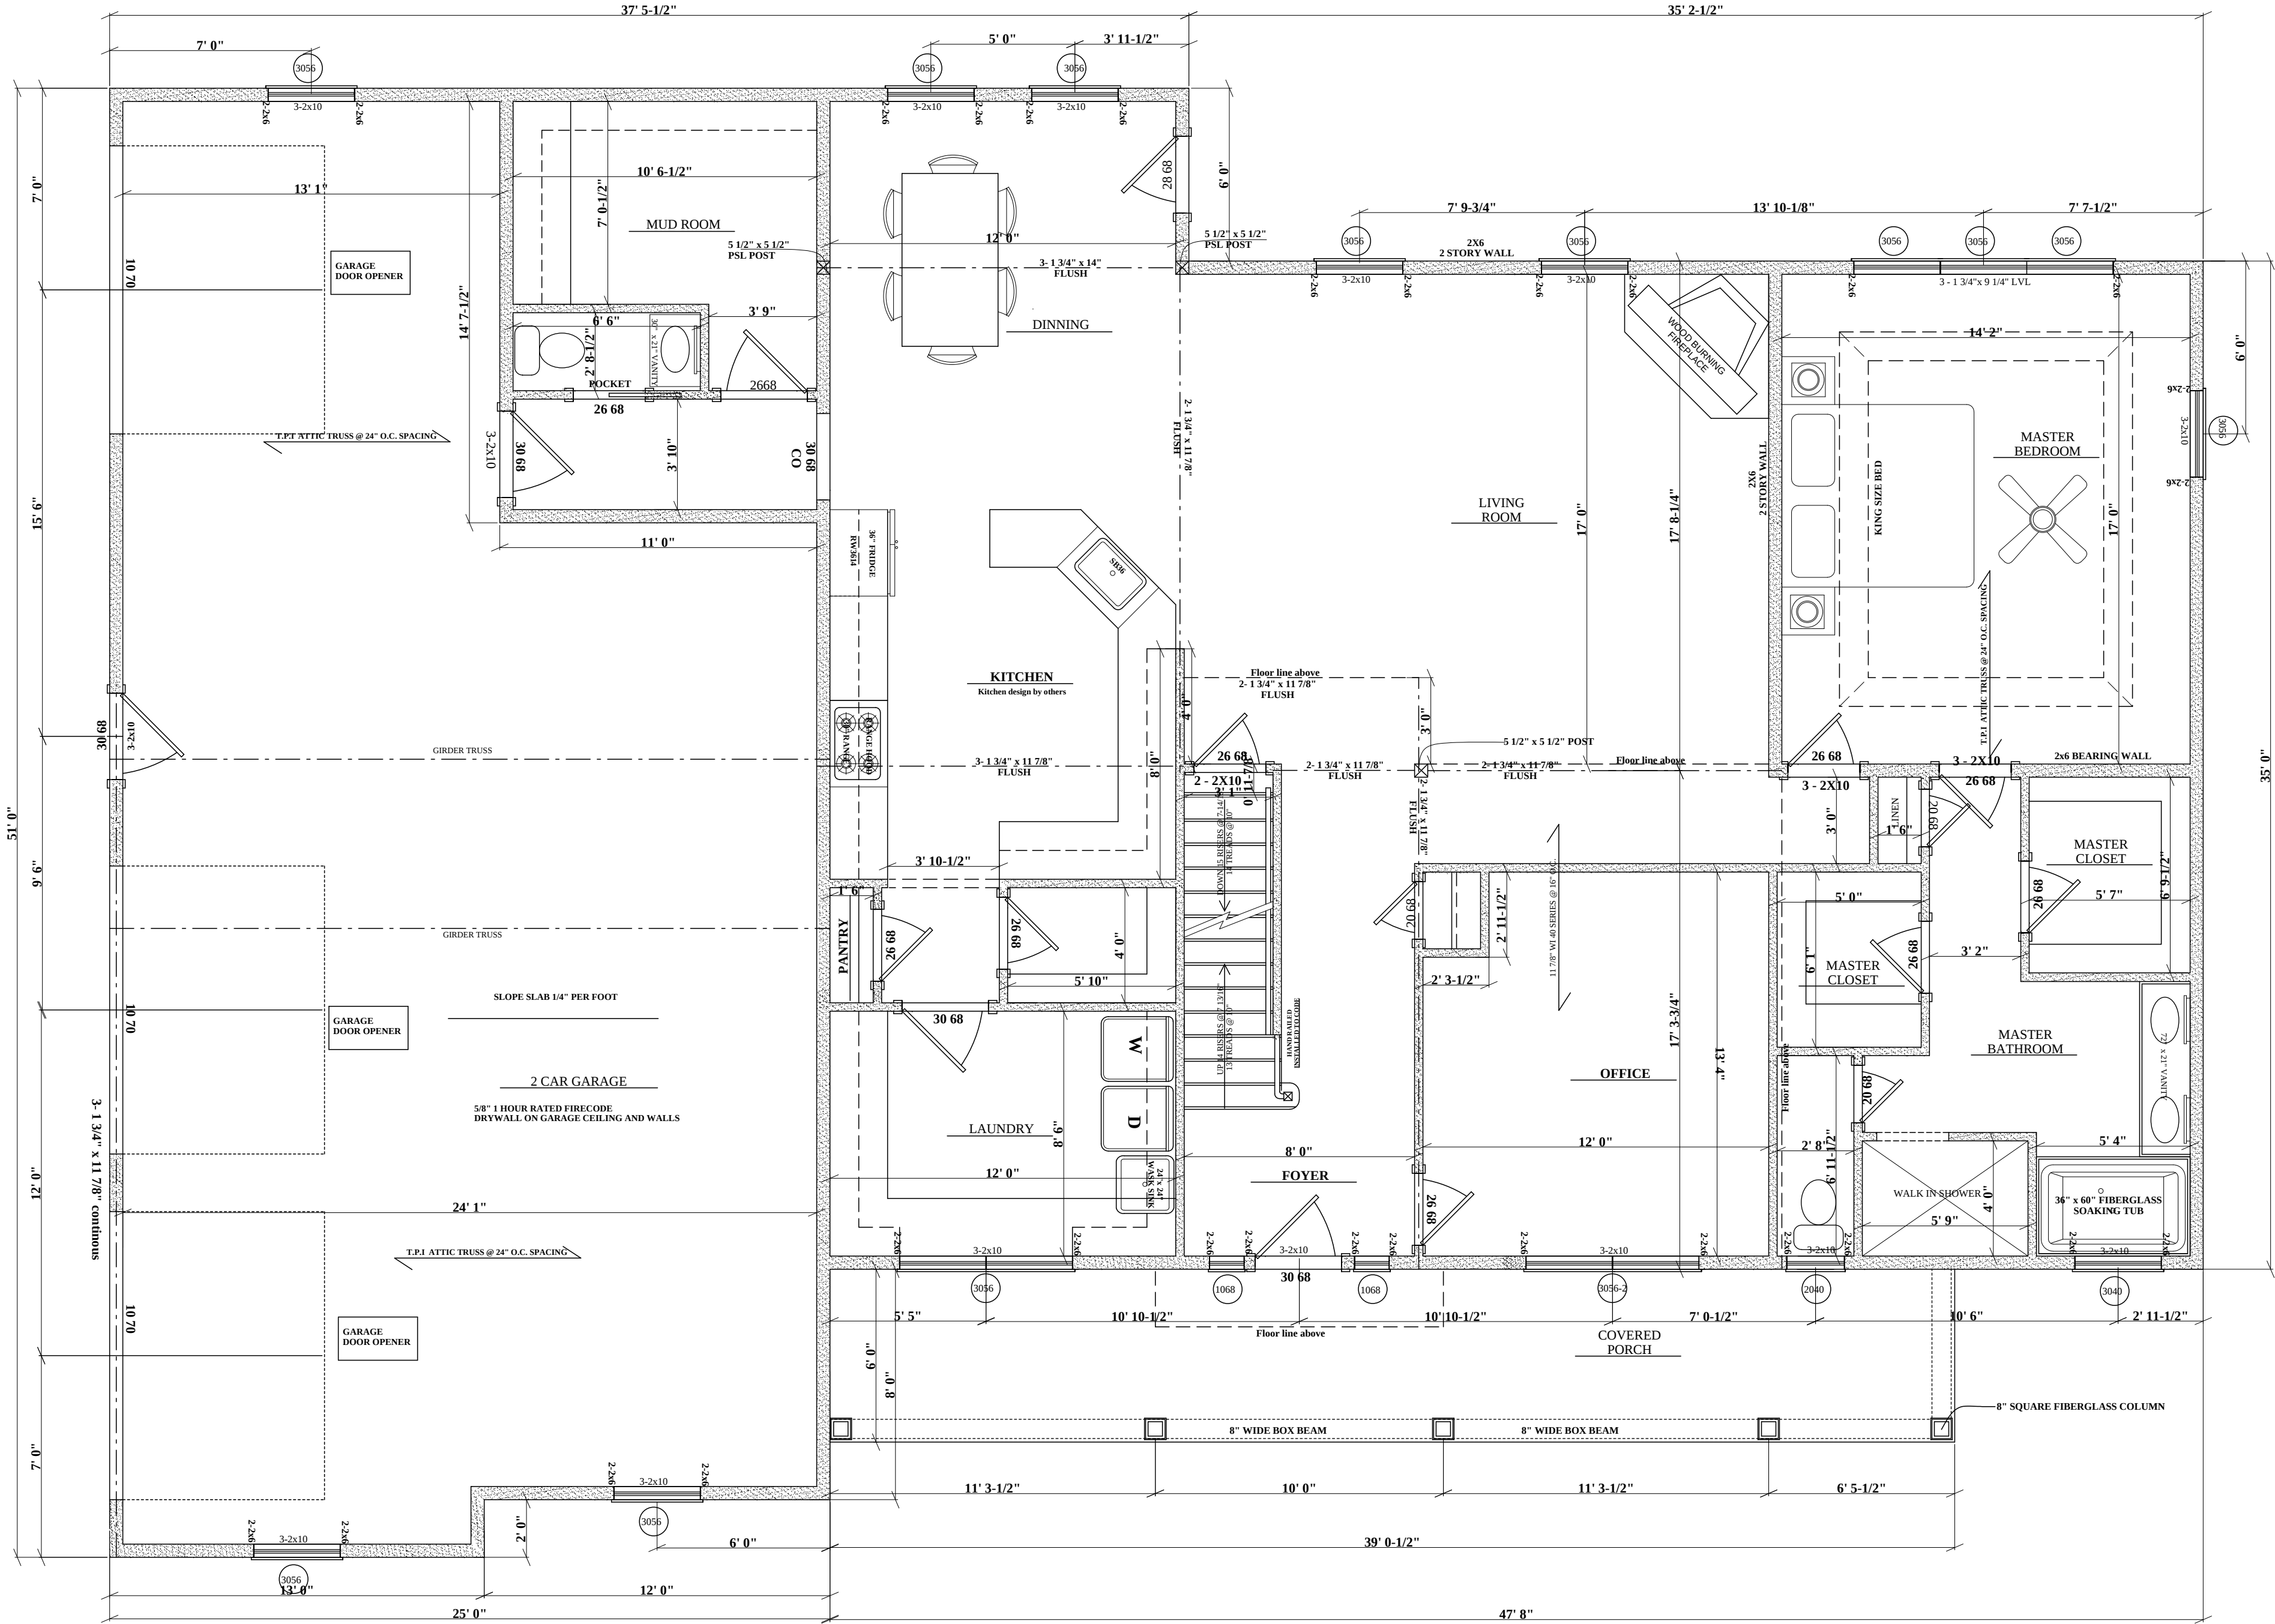

1ST FLOOR PLAN

Scale : 1/4" = 1ft. 1885 SQFT.

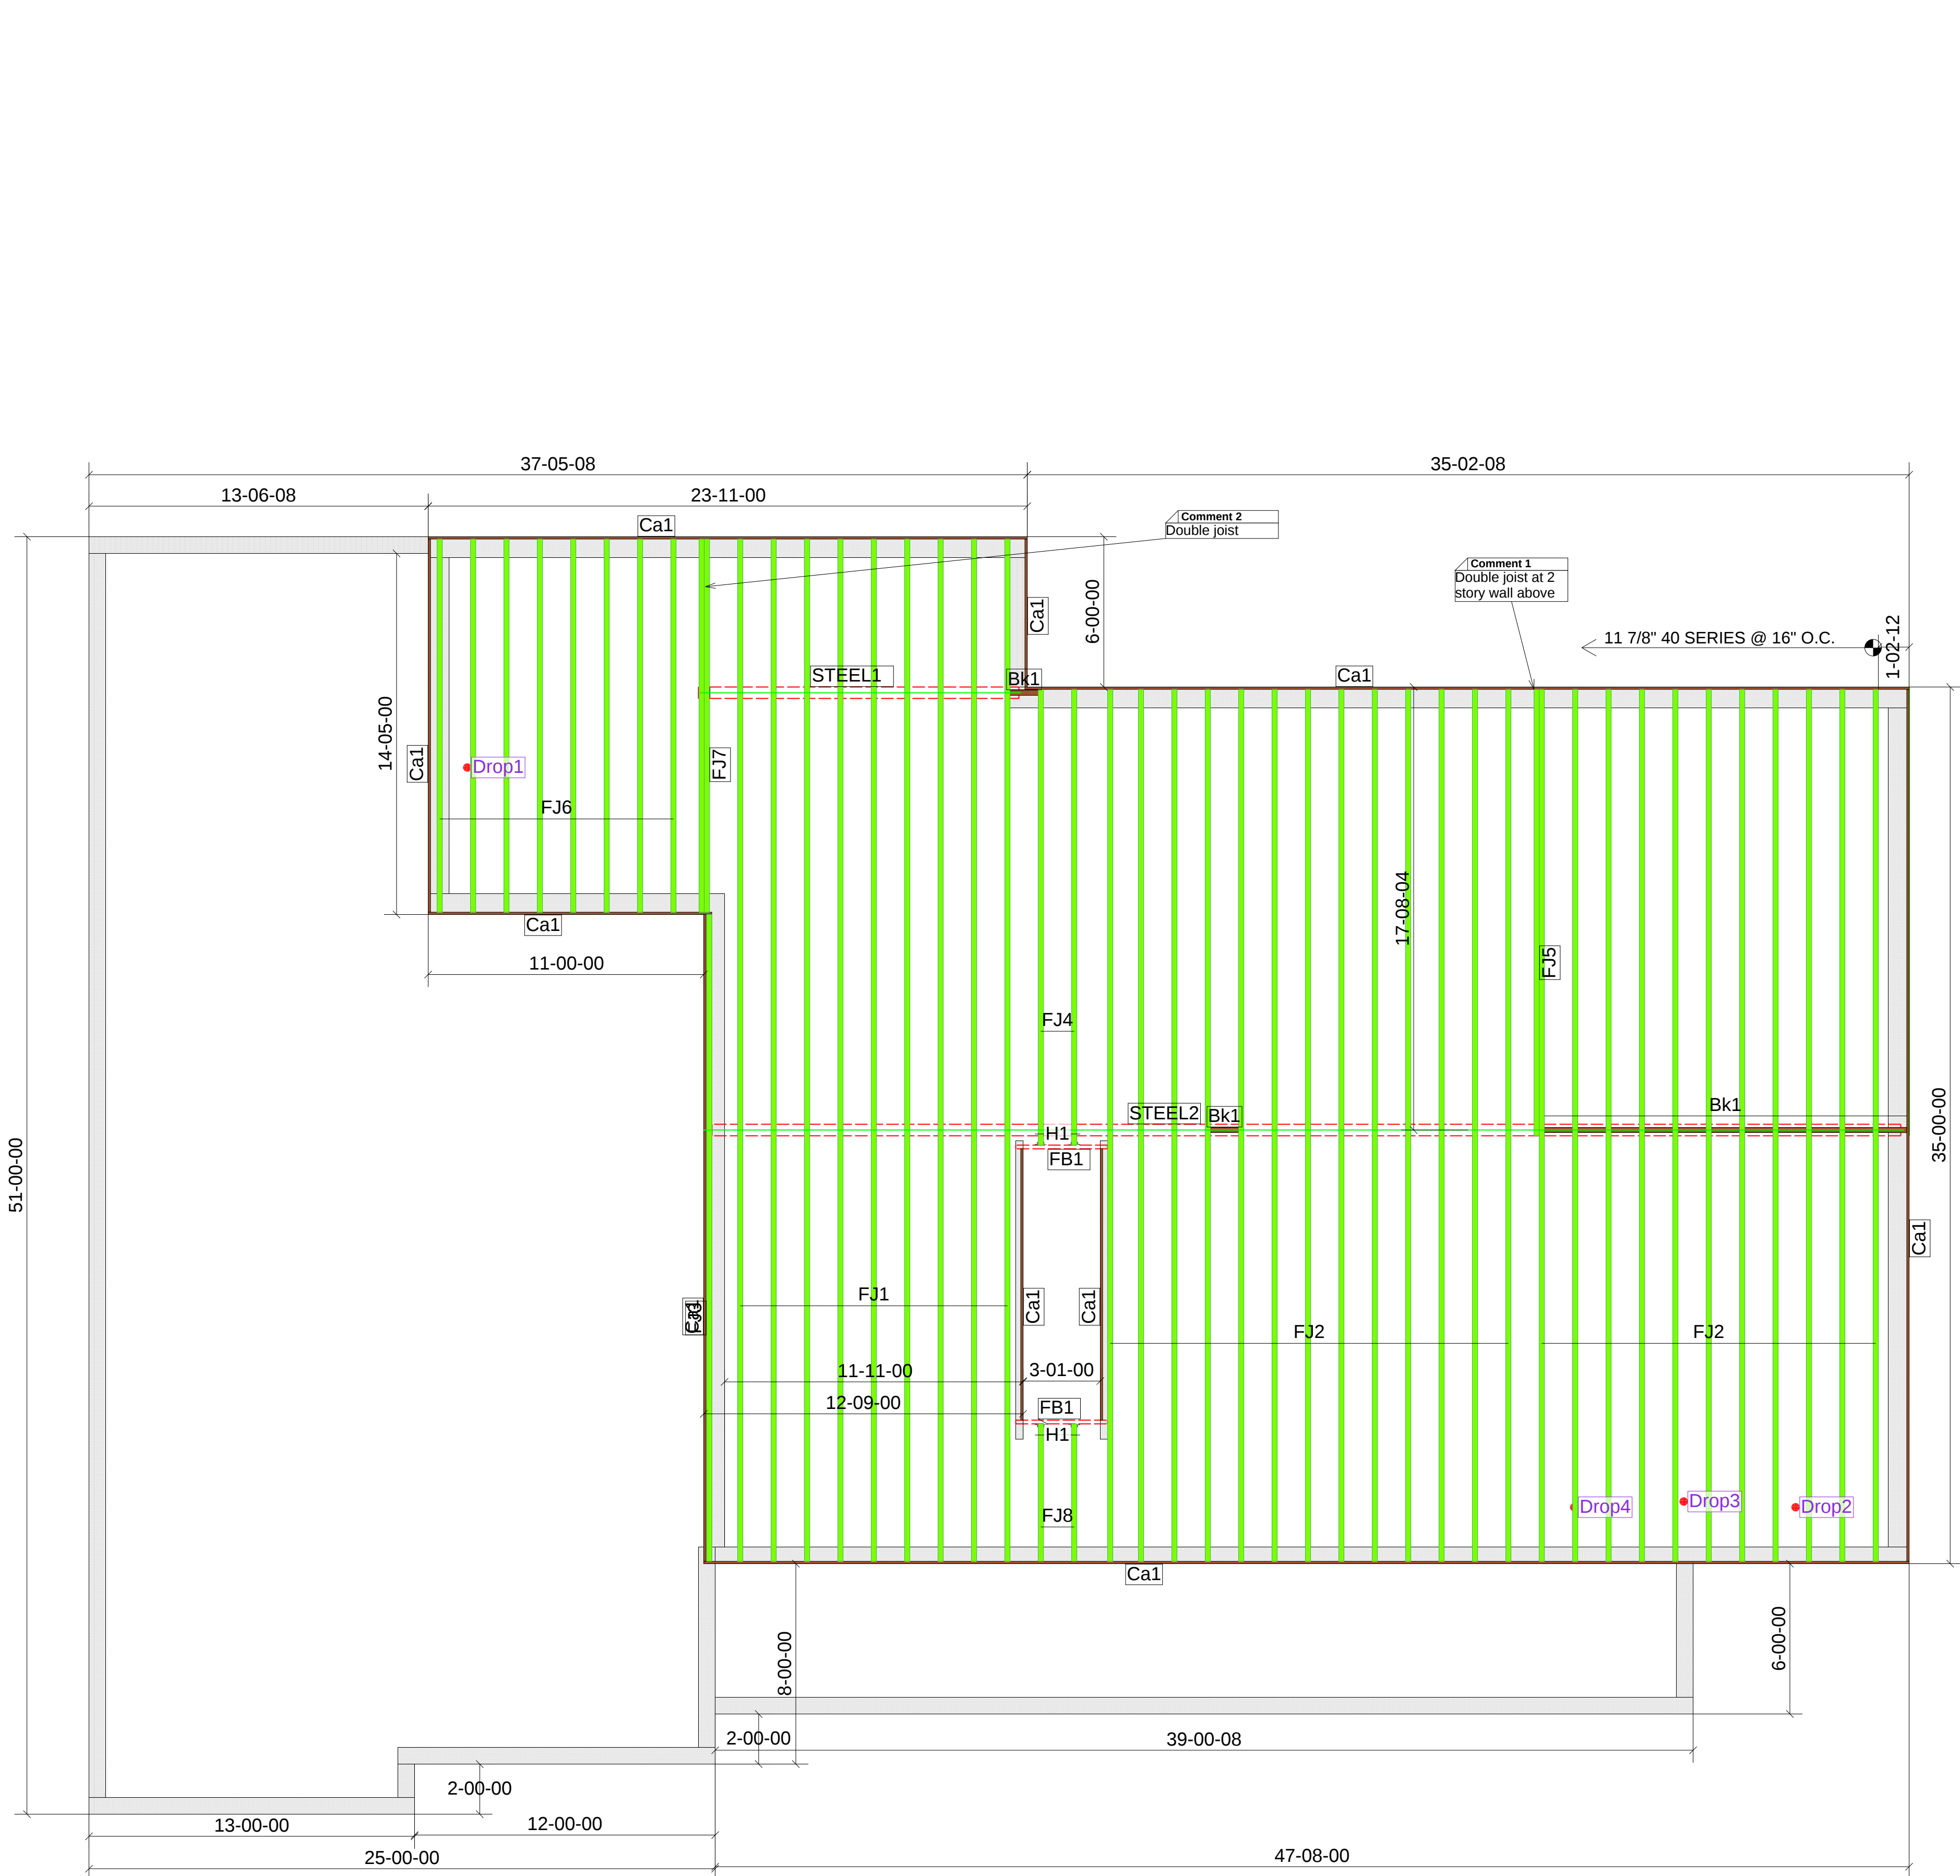

Products								
PlotID	Length	Product	Plies	Net Qty				
FJ1	42-00-00	11 7/8" WI 40	1	9				
FJ2	36-00-00	11 7/8" WI 40	1	24				
FJ3	26-00-00	11 7/8" WI 40	1	1				
FJ4	20-00-00	11 7/8" WI 40	1	2				
FJ5	18-00-00	11 7/8" WI 40	1	1				
FJ6	16-00-00	11 7/8" WI 40	1	8				
FJ7	16-00-00	11 7/8" WI 40	2	2				
FJ8	6-00-00	11 7/8" WI 40	1	2				
FB1	4-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	1	2				
Ca1	12-00-00	GP FiberStrong Rim Board 1 1/8x11 7/8	1	19				
Bk1	2-00-00	11 7/8" WI 40	1	13				
Connector Summary								
PlotID	Qty	Manuf				Product	Skew	Slope
H1	4	Simpson				IUS 2.56/11.88	-	-

Verify all plumbing drops in field before setting joists

- Common truss:
- Piggy Back truss:
- Girder truss:
- Valley truss:

1st Floor Layout

Job Name :Samples Residence


Address :

Customer :

Designer :

Date:10/5/16

Job # : Scale 1/4"= 1'

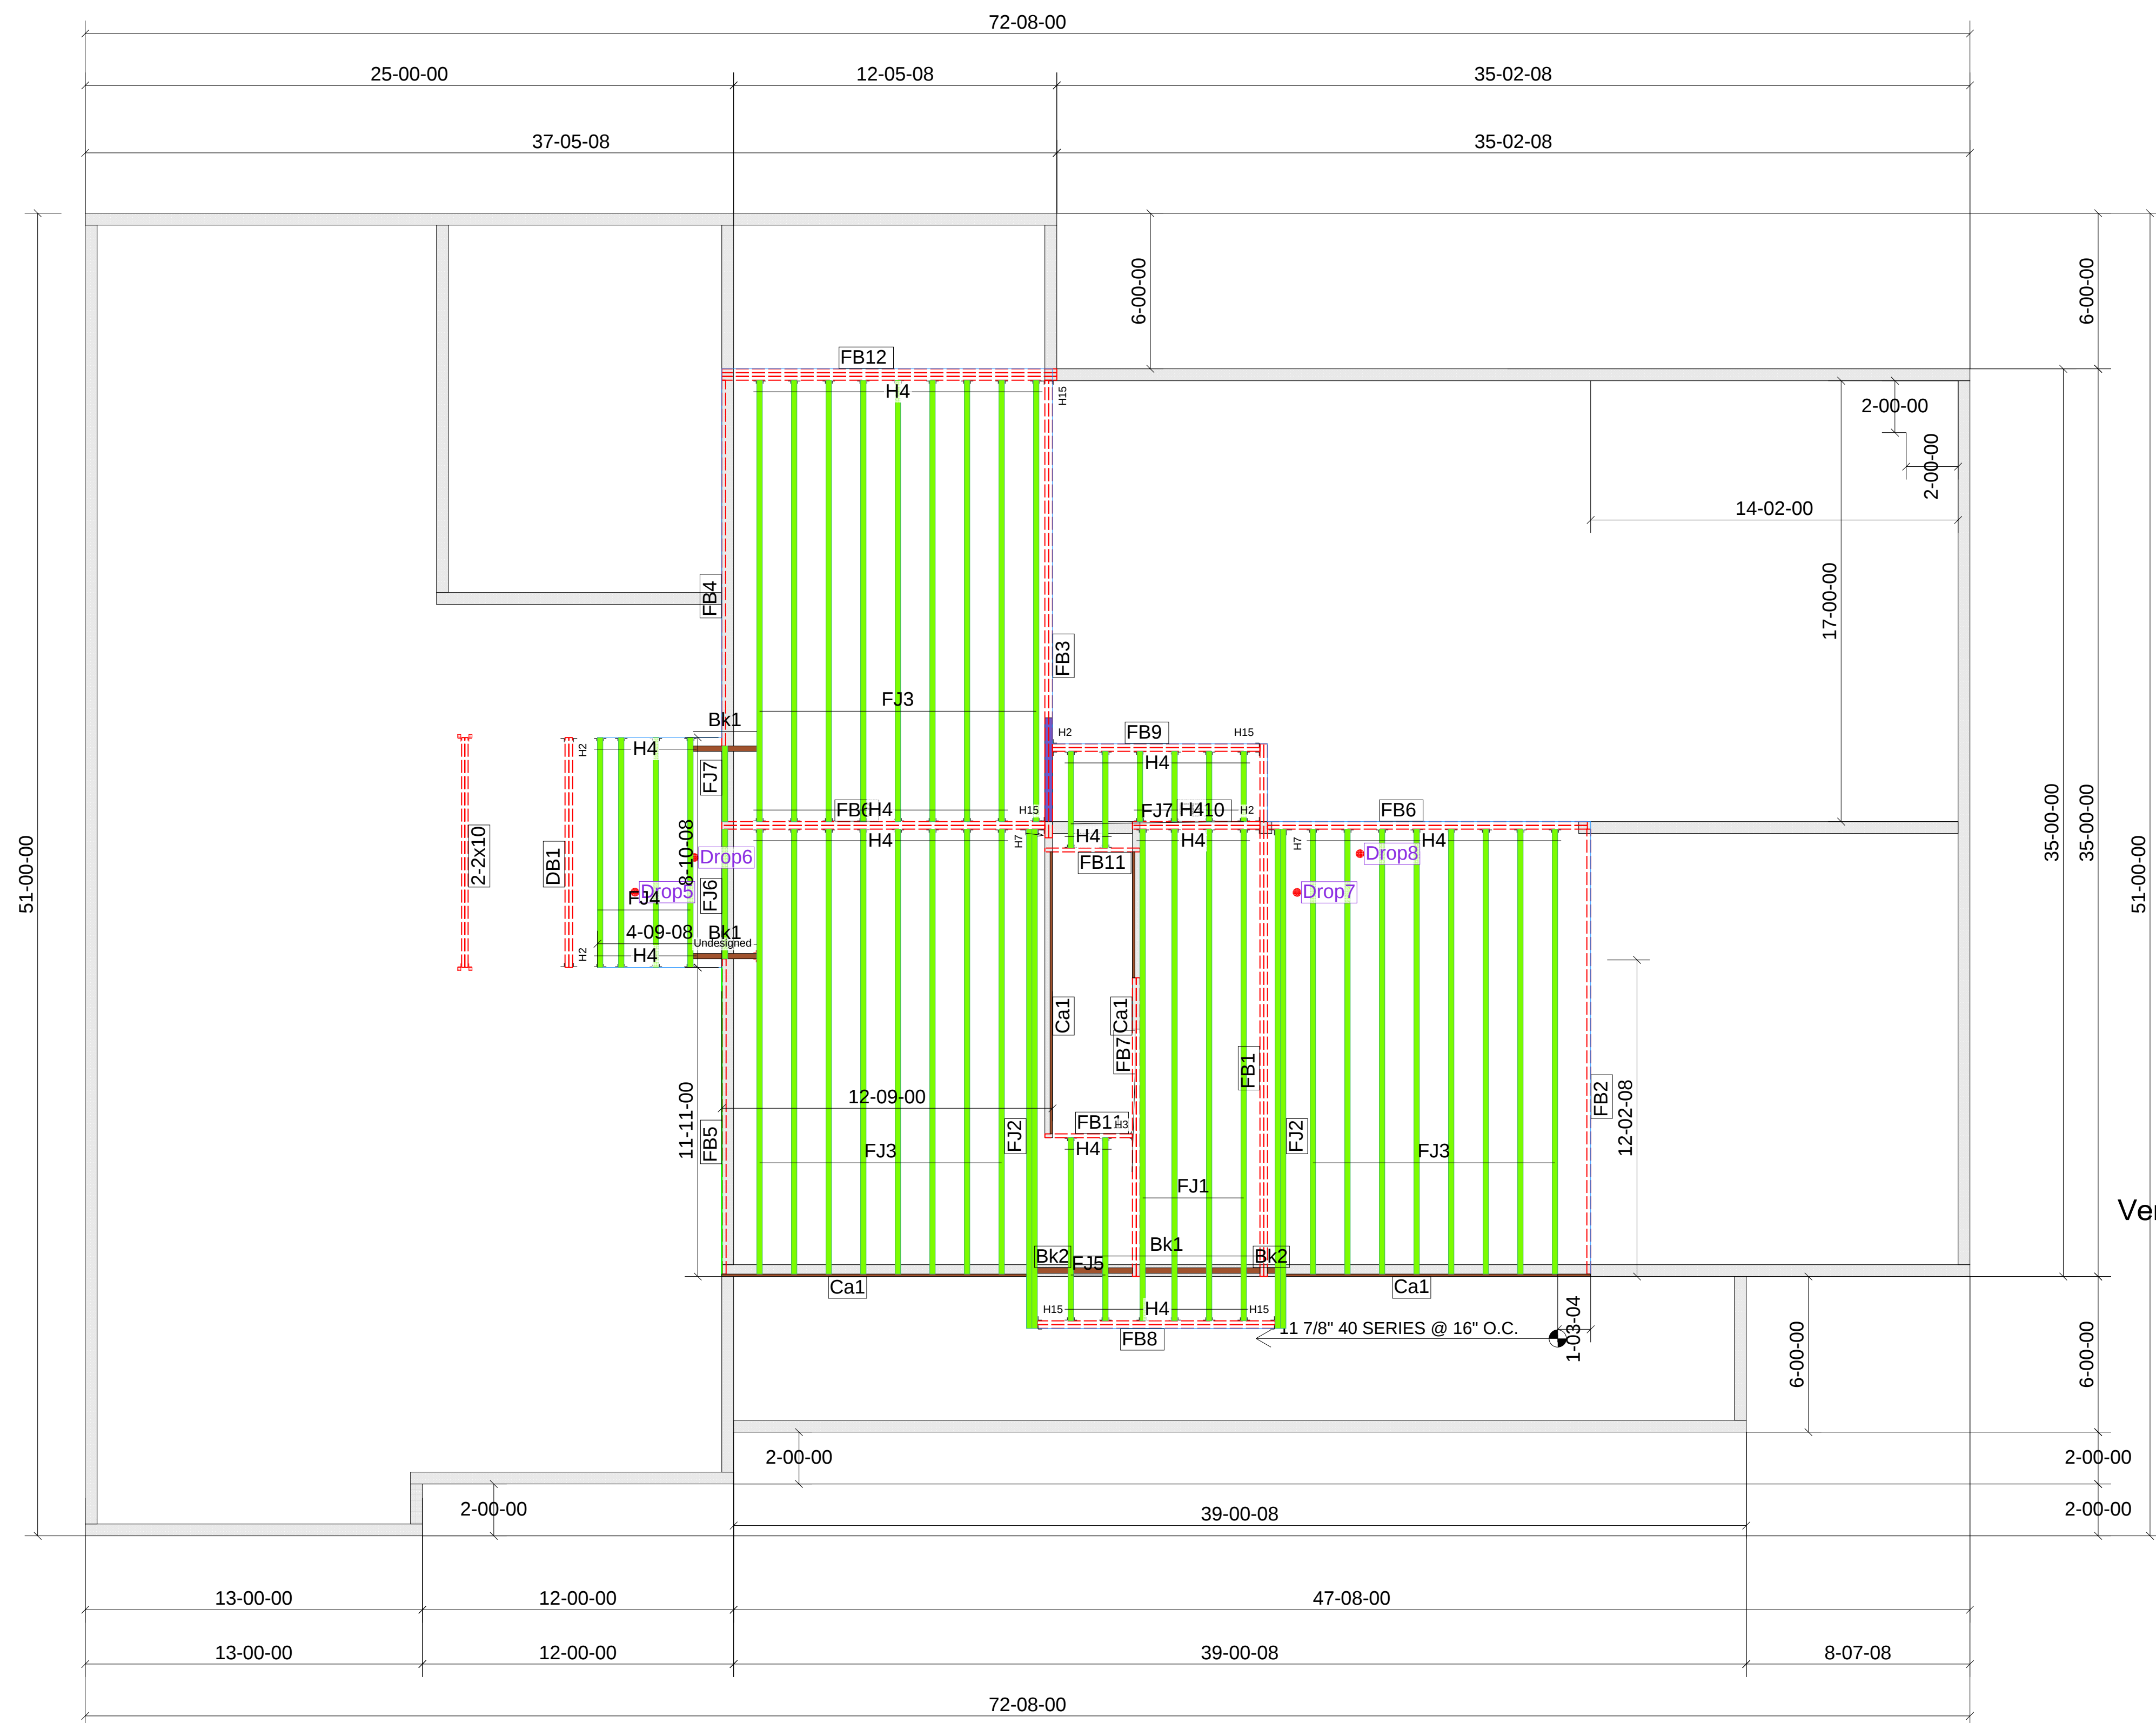

Products				
PlotID	Length	Product	Plies	Net Qty
FJ1	20-00-00	11 7/8" WI 40	1	4
FJ2	20-00-00	11 7/8" WI 40	2	4
FJ3	18-00-00	11 7/8" WI 40	1	25
FJ4	10-00-00	11 7/8" WI 40	1	4
FJ5	8-00-00	11 7/8" WI 40	1	2
FJ6	6-00-00	11 7/8" WI 40	1	1
FJ7	4-00-00	11 7/8" WI 40	1	7
FB1	22-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
FB2	18-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	1	1
FB3	18-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
FB4	16-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	1	1
FB5	14-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	1	1
FB6	14-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	4
FB7	12-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
DB1	10-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
FB8	10-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
FB9	8-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
FB10	6-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	2	2
FB11	4-00-00	GP Lam 2.0E LVL 1 3/4x11 7/8	1	2
FB12	14-00-00	GP Lam 2.0E LVL 1 3/4x14	3	3
Ca1	12-00-00	GP FiberStrong Rim Board 1 1/8x11 7/8	1	4
Bk1	2-00-00	11 7/8" WI 40	1	10
Bk2	2-00-00	11 7/8" WI 40	1	2

Connector Summary					
PlotID	Qty	Manuf	Product	Skew	Slope
H2	4	Simpson	HHUS410	-	-
H3	1	Simpson	HUS1.81/10	-	-
H4	66	Simpson	IUS 2.56/11.88	-	-
H5	1	Simpson	LTHJA26	-	-
H6	1	Simpson	LUS26	-	-
H7	2	Simpson	MIU 5.12/11	-	-
H8	2	Simpson	TJC37	-	-
H15	5		HUC410	-	-

Verify all plumbing drops in field before setting joists

2nd Floor Layout

Job Name :Samples Residence

Address :

Customer :

Designer :

Date: 10/5/16

Job # ::

Scale 1/4"= 1'

- Common truss:
- Piggy Back truss:
- Girder truss:
- Valley truss:

Roof Truss Layout

Scale 1/4"= 1'

Job # :

Job Name :Samples Residence

Address :

Customer :

Designer :

Date:10/5/16

Connector Summary					
PlotID	Qty	Manuf	Product	Skew	Slope
H1	2	Simpson	HGUS210-3	-	-
H2	4	Simpson	HGUS26-2	-	-
H3	2	Simpson	HHUS410	-	-
H4	1	Simpson	HUS1.81/10	-	-
H5	13	Simpson	HUS210	-	-
H6	58	Simpson	IUS 2.56/11.88	-	-
H7	1	Simpson	LTHJA26	-	-
H8	4	Simpson	LUS210	-	-
H9	5	Simpson	LUS26	-	-
H10	2	Simpson	MIU 5.12/11	-	-
H11	2	Simpson	TJC37	-	-
H18	5		HUC410	-	-

Connector Summary					
PlotID	Qty	Manuf	Product	Skew	Slope
H1	2	Simpson	HHUS26-2	-	-
H2	4	Simpson	HUS26	-	-
H3	18	Simpson	LSU26	-	-