


CLASS I AEROBIC UNIT - 500 GAL./DAY; USE EXISTING TANK/S FOR PRE-TREATMENT; 500 GALLON PUMP CHAMBER W/ALARM; 1" PVC PRESSURE LINE TO SEVEN SPRINKLERS WITH 4,650 SQ.FT. OF APPLICATION AREA:

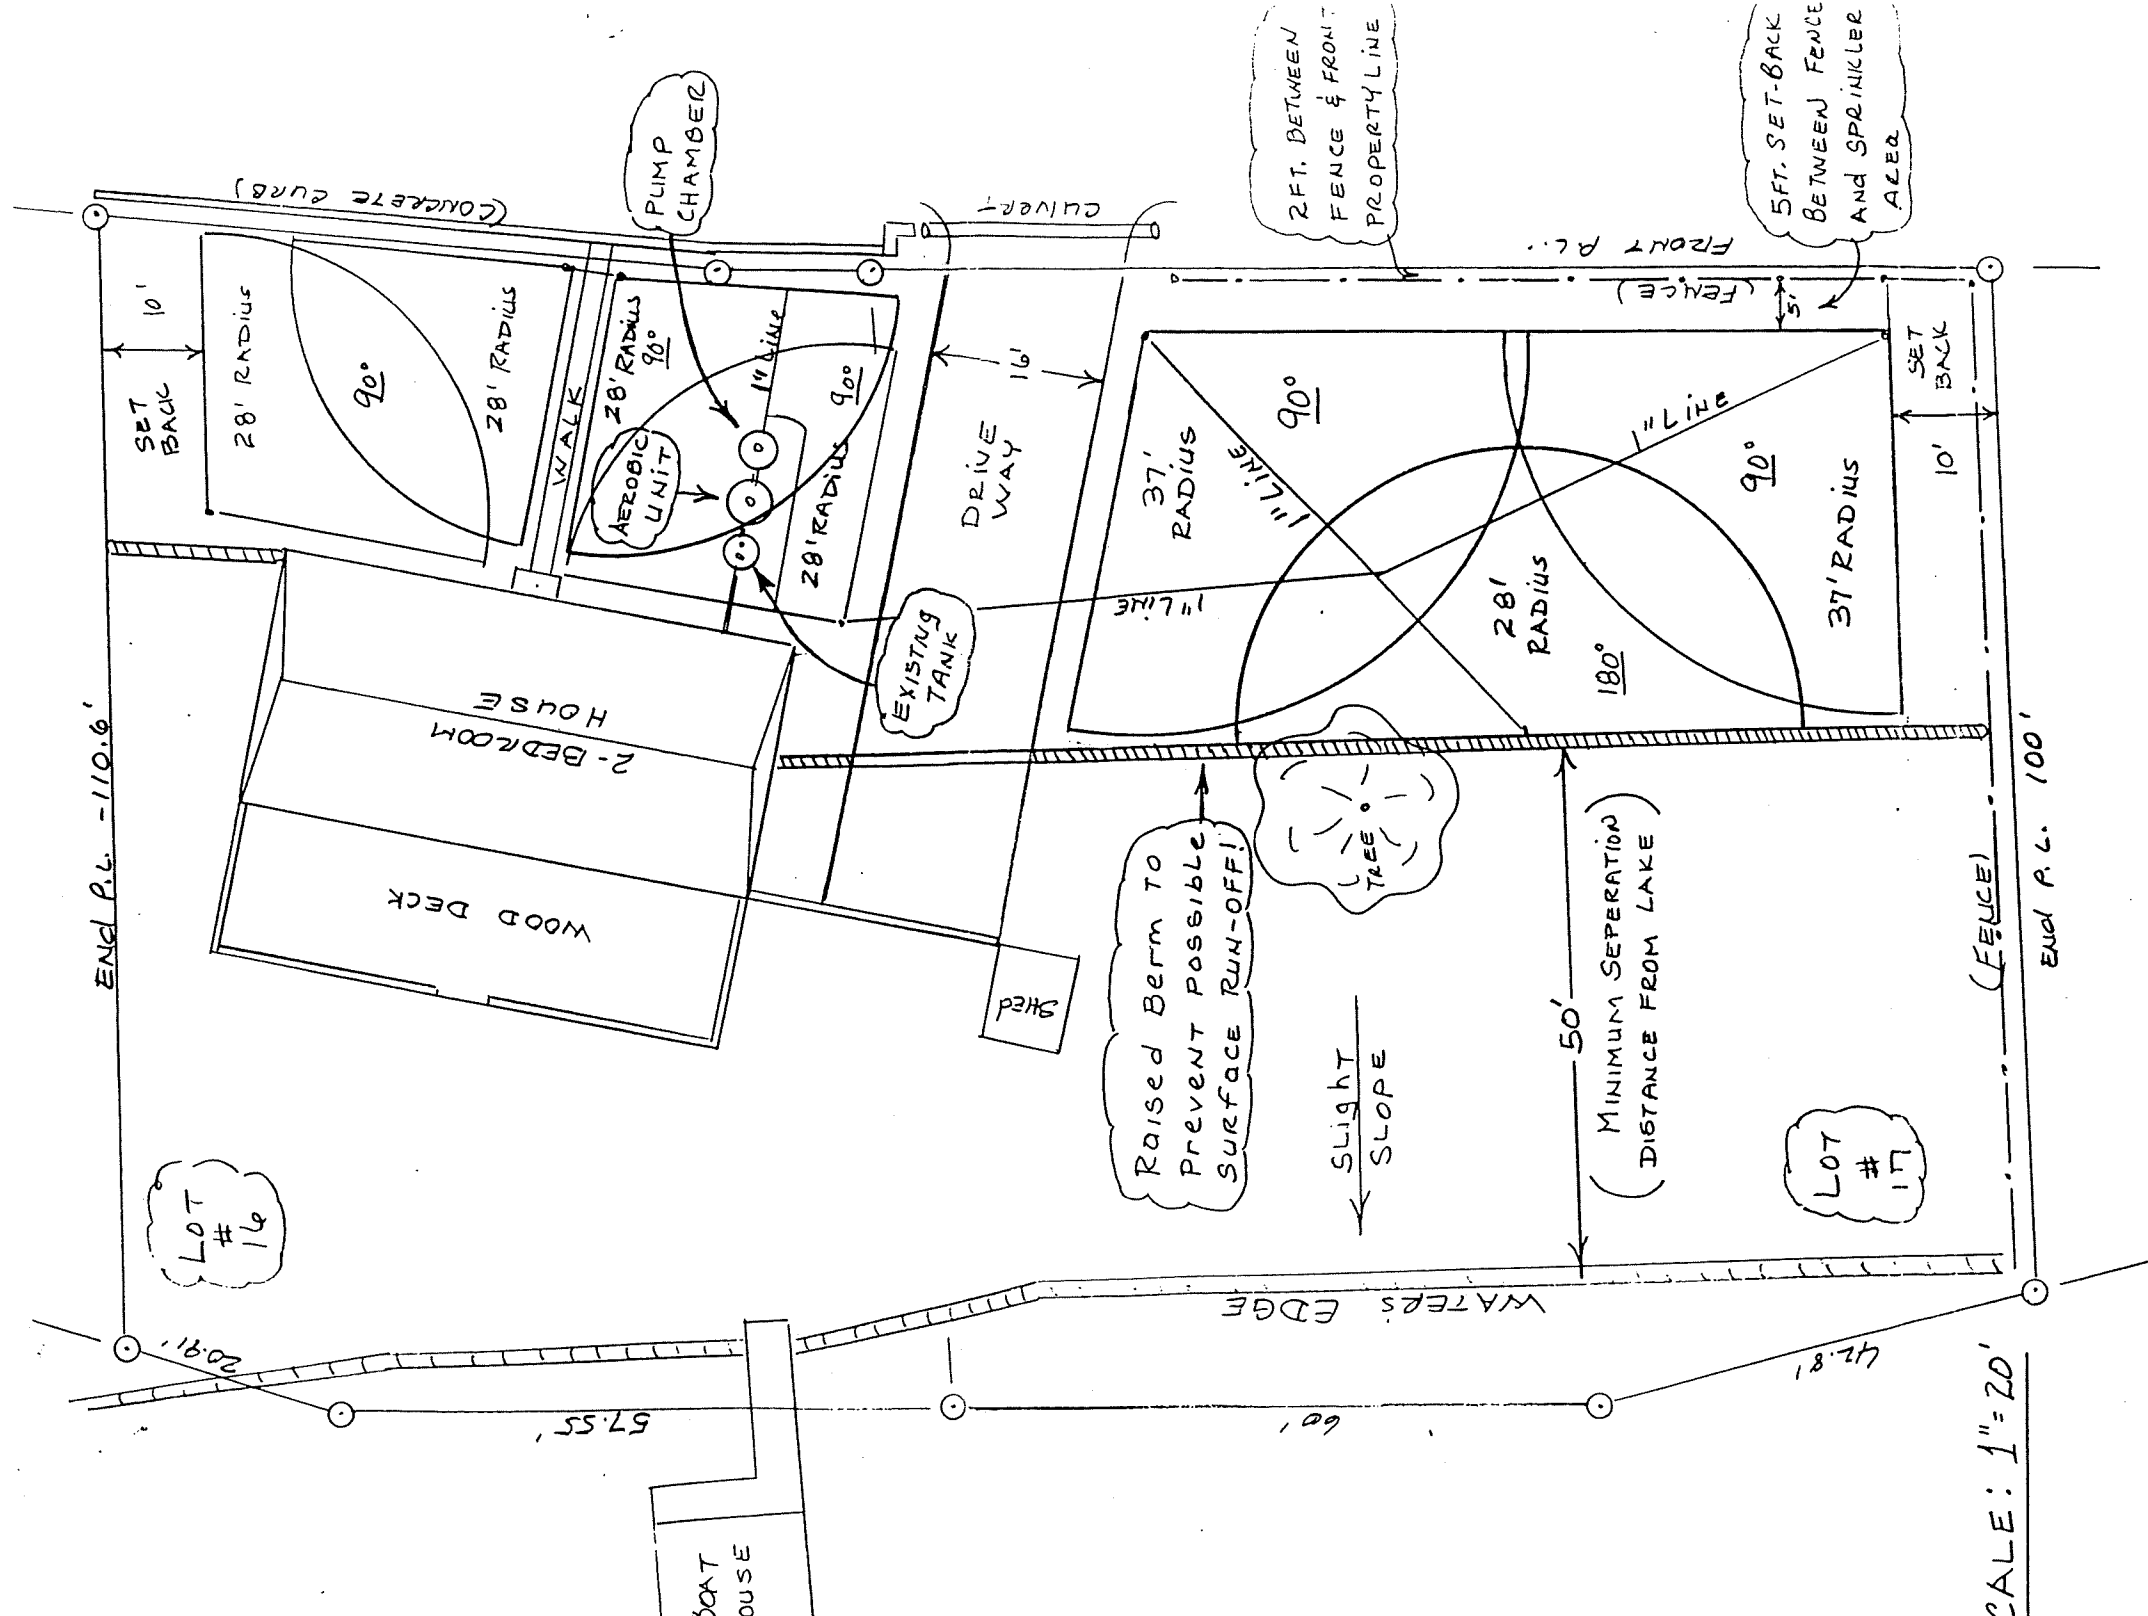

T.A. BOEKER
R.S. # 1797